




**Mastercool<sup>®</sup>** Inc.  
*"World Class Quality"*

## 91499 SUPERHEAT DETERMINATION SET

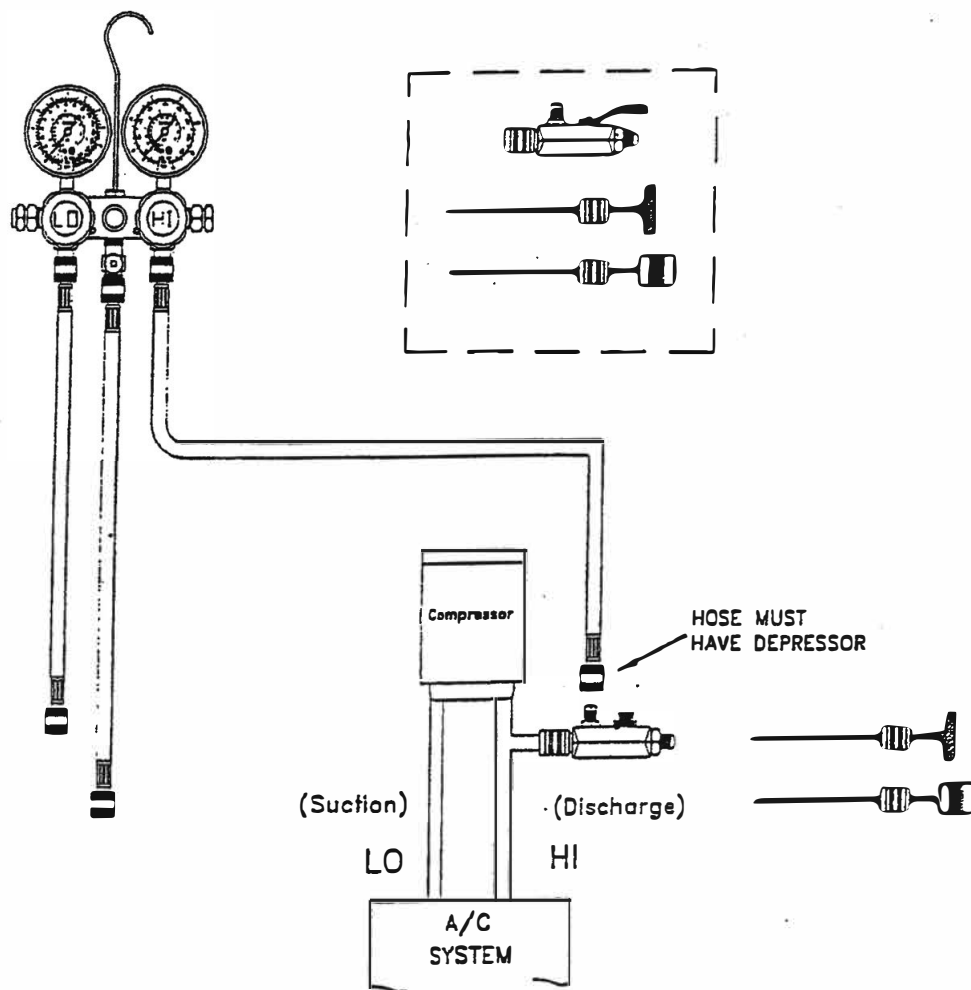

1. Connect core remover to service tool.
2. Connect service tool to system.
3. Remove core valve & pull core removal tool back.
4. Close service valve.
5. Remove valve core remover and install thermometer.
6. Open service valve and insert thermometer.
7. Connect manifold gauge to service tool. Hose must have depressor!

**NOTE:** System pressure T2 and temperature T1.

**⚠ WARNING:** This product can expose you to chemicals including Di (2-ethylhexyl) phthalate, lead and lead compounds, which are known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)